


OUTDOOR UNIT: PURY-P336TSNU-A(-BS) – DIMENSIONS

PURY-P336TSNU-A(-BS)

Unit: mm(in)

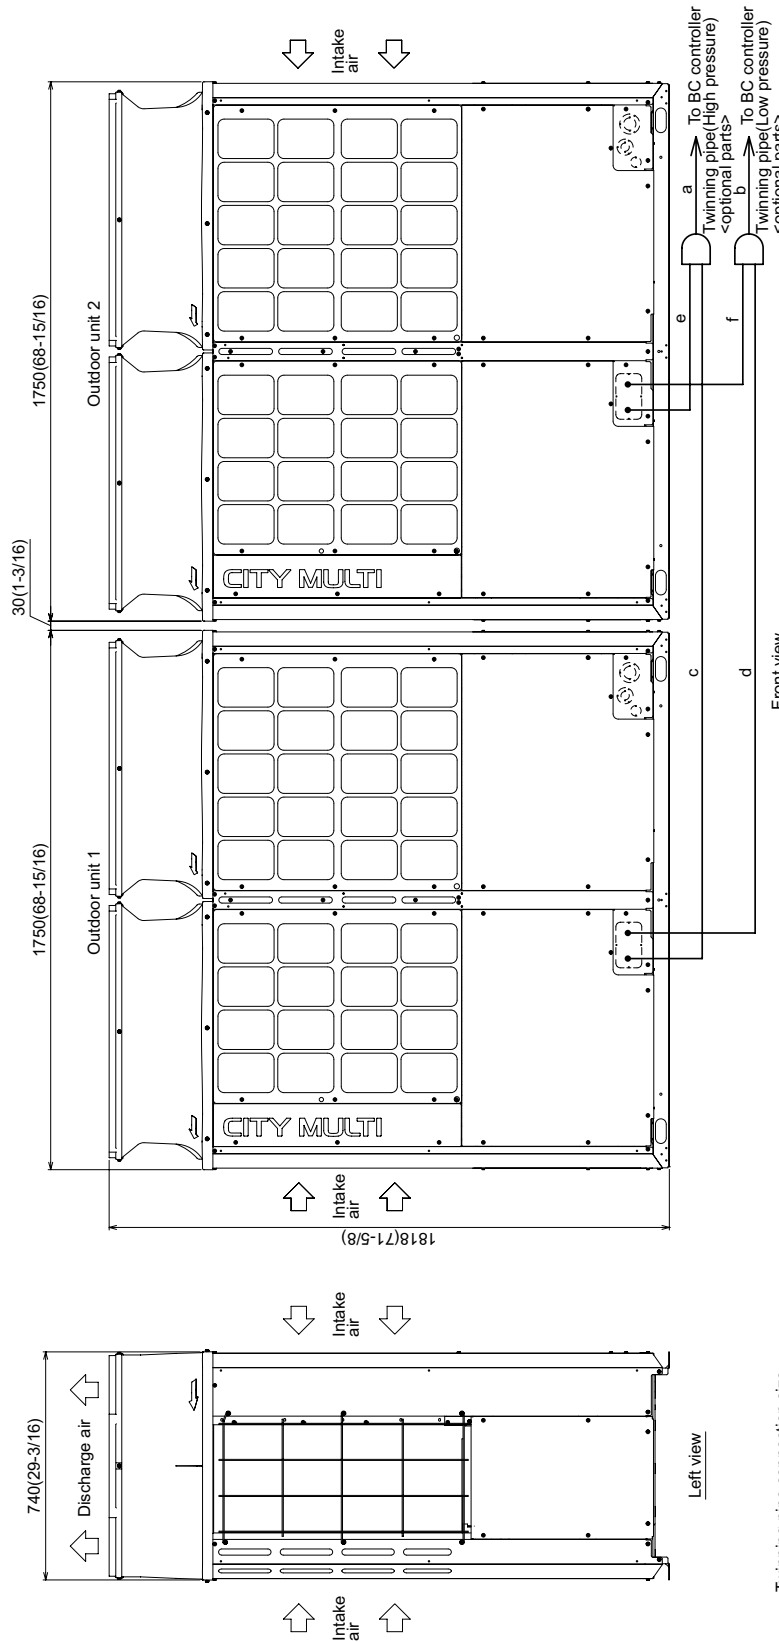

Twinning pipe connection size

| | | |
|--------------------------------------|----------------------|---------------------|
| Package unit name | PURY-P336TSNU-A(-BS) | |
| Component unit name | Outdoor unit 1 | PURY-P168TNU-A(-BS) |
| | Outdoor unit 2 | PURY-P168TNU-A(-BS) |
| Outdoor Twinning Kit(optional parts) | CMY-R300NCBK | |
| BC controller | High pressure | a |
| | Low pressure | b |
| | | ø41.28(1-5/8) |

| | |
|----------------------------|---------------|
| Unit model | P168 |
| Twinning pipe-Outdoor unit | ø22.2(7/8) |
| High pressure | c or e |
| Low pressure | d or f |
| | ø28.58(1-1/8) |


- Note 1. Connect the pipes as shown in the figure above. Refer to the table above for the pipe size.
 Note 2. Twinning pipes should not be tilted more than 15 degrees from the horizontal plane.
 Be sure to see the Installation Manual for details of Twinning pipe installation.
 Note 3. The pipe section before the Twinning pipe (section "a" and "b" in the figure) must have at least 500mm(19-11/16) of straight section (*including the straight pipe that is supplied with the Twinning pipe).
 Note 4. Only use the Twinning pipe by Mitsubishi (optional parts).

NOTES:
 SEACOAST PROTECTION
 Anti-corrosion Protection: A coating treatment is applied to condenser coil for protection from air contaminants.
 Standard: Salt Spray Test Method - no unusual rust development to 480 hours.
 Sea Coast (BS): Salt Spray Test Method (JRA 9002) - no unusual rust development to 960 hours.

MODULE 1: PURY-P168TNU-A(-BS) – DIMENSIONS

PURY-P168TNU-A(-BS)

Unit: mm(in)

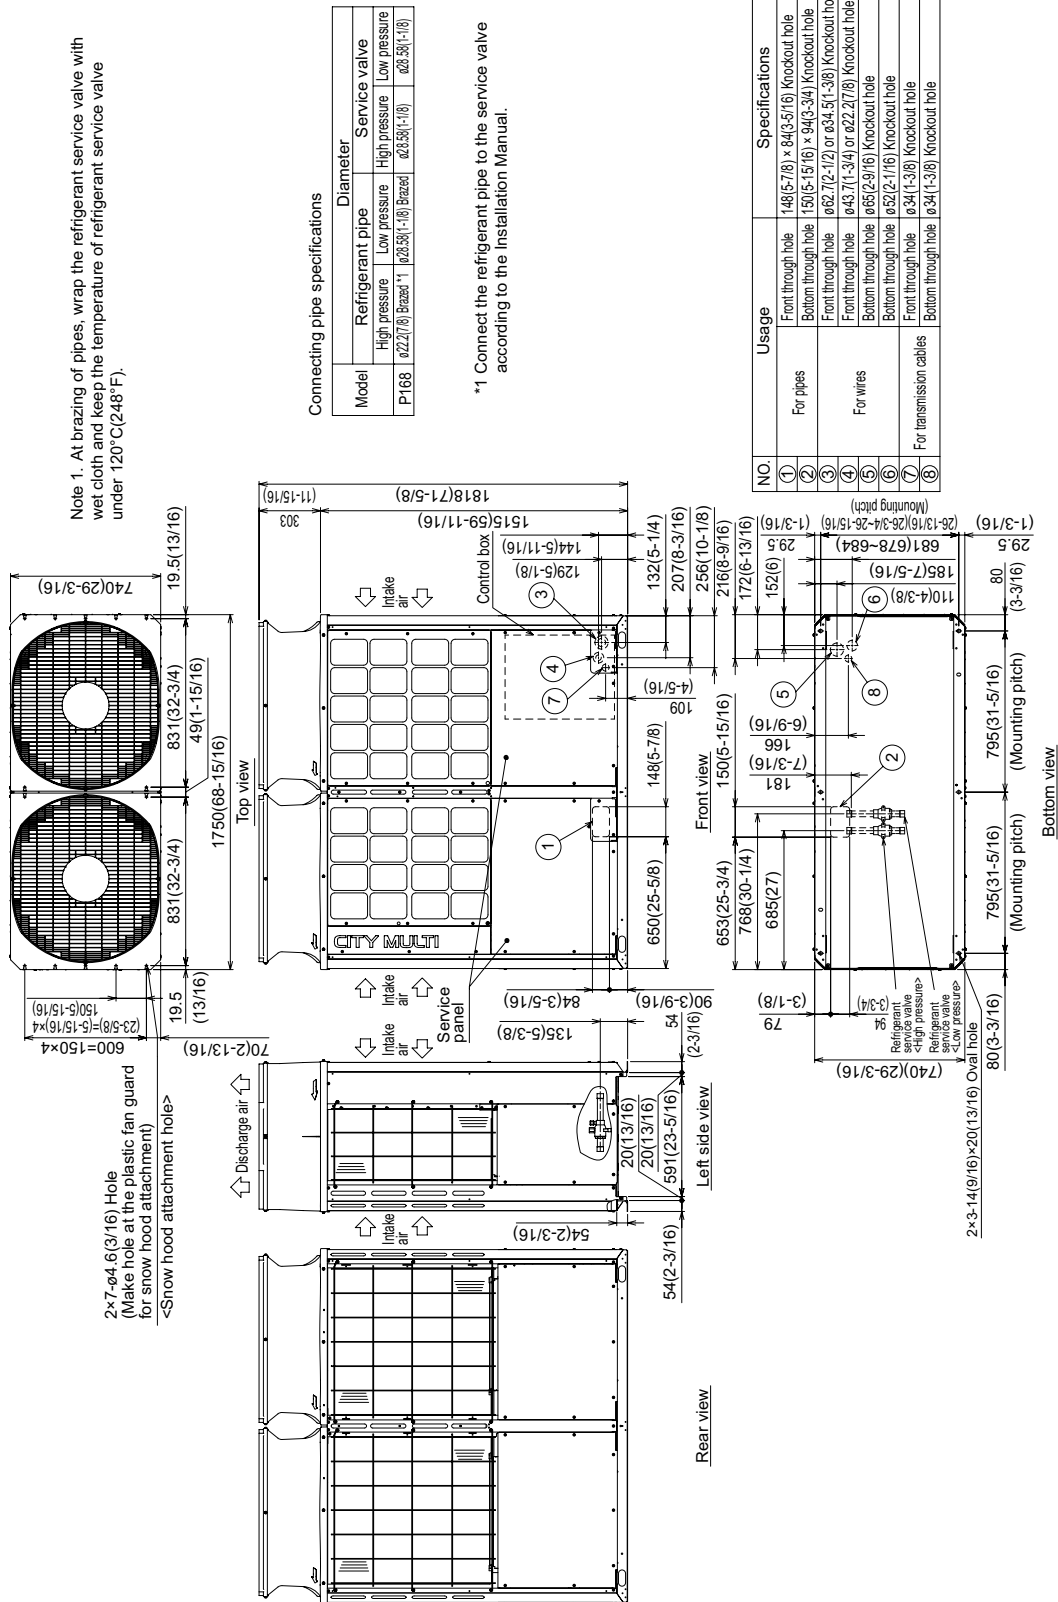


NOTES:
SEACOAST PROTECTION

Anti-corrosion Protection: A coating treatment is applied to condenser coil for protection from air contaminants.
Standard: Salt Spray Test Method - no unusual rust development to 480 hours.
Sea Coast (BS): Salt Spray Test Method (JRA 9002) - no unusual rust development to 960 hours.

MODULE 2: PURY-P168TNU-A(-BS) – DIMENSIONS

PURY-P168TNU-A(-BS)

Unit: mm(in)

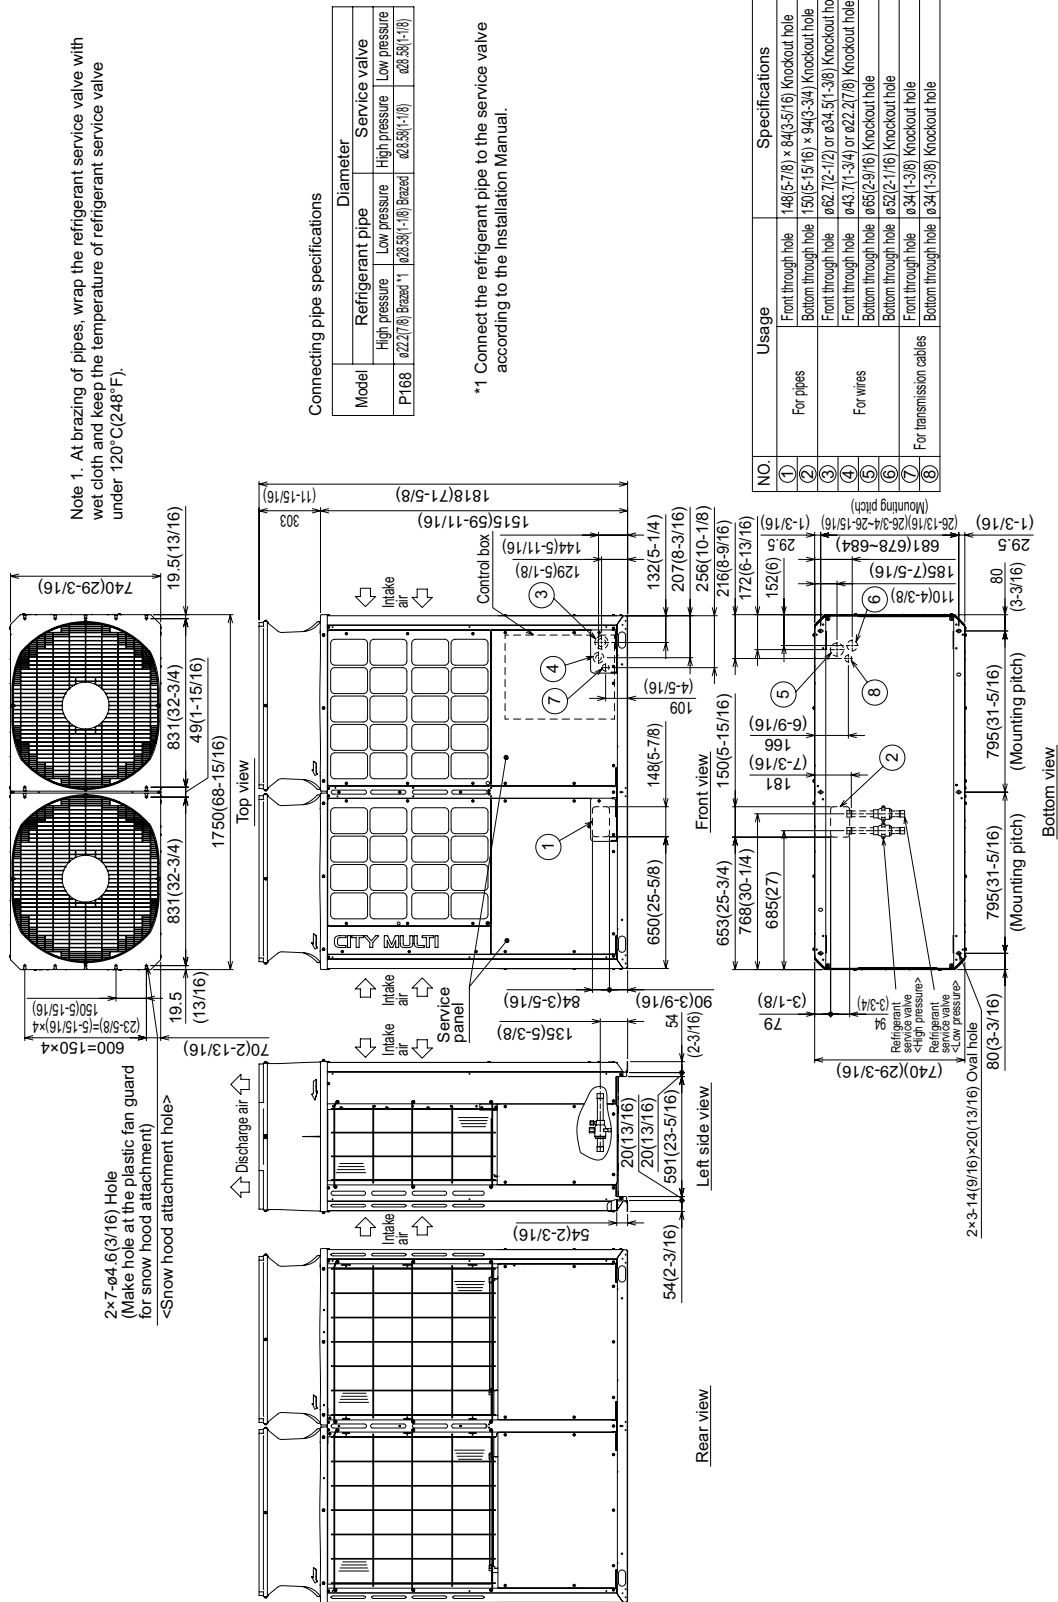

NOTES:
SEACOAST PROTECTION


Anti-corrosion Protection: A coating treatment is applied to condenser coil for protection from air contaminants.
Standard: Salt Spray Test Method - no unusual rust development to 480 hours.
Sea Coast (BS): Salt Spray Test Method (JRA 9002) - no unusual rust development to 960 hours.

TWINNING KIT: CMY-R300NCBK – DIMENSIONS


CMY-R300NCBK

Unit: mm (in.)

Low-pressure twinning pipe

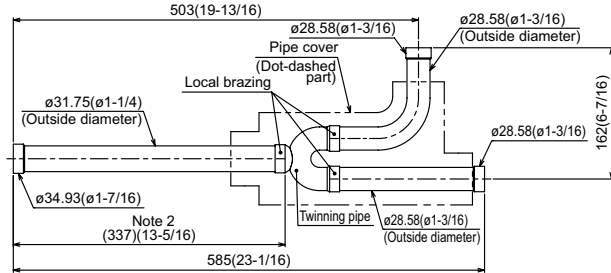


<Deformed pipe(Accessory)>



Note:


1. Refer to the figure below for the installation position of the twinning pipe.




Slope of the twinning pipes are at an angle within $\pm 15^\circ$ to the horizontal plane.

2. Use the attached pipe to braze the port-opening of the twinning pipe.
3. Pipe diameter is indicated by inside diameter.


High-pressure twinning pipe



<Deformed pipe(Accessory)>



Note 1. Reference the attitude angle of the twinning pipe below the fig.



The angle of the twinning pipe is within $\pm 15^\circ$ against the horizontal plane.

2. Use the attached pipe to braze the port-opening of the twinning pipe.
3. Pipe diameter is indicated by inside diameter.
4. Only use the Twinning pipe by Mitsubishi (optional parts) .

1340 Satellite Boulevard Suwanee, GA 30024
Toll Free: 800-433-4822 www.mehvac.com

FORM# PURY-P336TSNU-A - 202107

